


Notes

- 1) Drawings are not to scale. All dimensions are in feet and inches. Weights are in pounds and include options and accessories.
- 2) Operating weight and weight loading are for units with water level in basin at overflow.
- 3) Unit support beams and anchor bolts to be designed and furnished by others.
- 4) Support beams must be flush and level at top.
- 5) All supporting steelwork must be designed in accordance with accepted structural practice. Maximum deflection of steelwork under unit to be 1/360 of span, not to exceed 1/2".
- 6) Each beam should be designed, as a minimum, for 65% of the total unit operation weight applied as a uniformly distributed load.

PLAN A STEEL SUPPORT

Model Number	Approx, Shipping Weight	Approx, Operating Weight
PCC-0538-2012N060	25320	37230
PCC-0416-2012N020	25590	37550
PCC-0466-2012N030	25840	37800
PCC-0544-2012N040	29670	41790
PCC-0562-2012N050	28740	40860
PCC-0590-2012N060	28840	40960
PCC-0630-2012N080	30260	42440
PCC-0646-2012N060	35890	48400
PCC-0492-2012N020	36920	49530
PCC-0656-2012N060	37490	50110

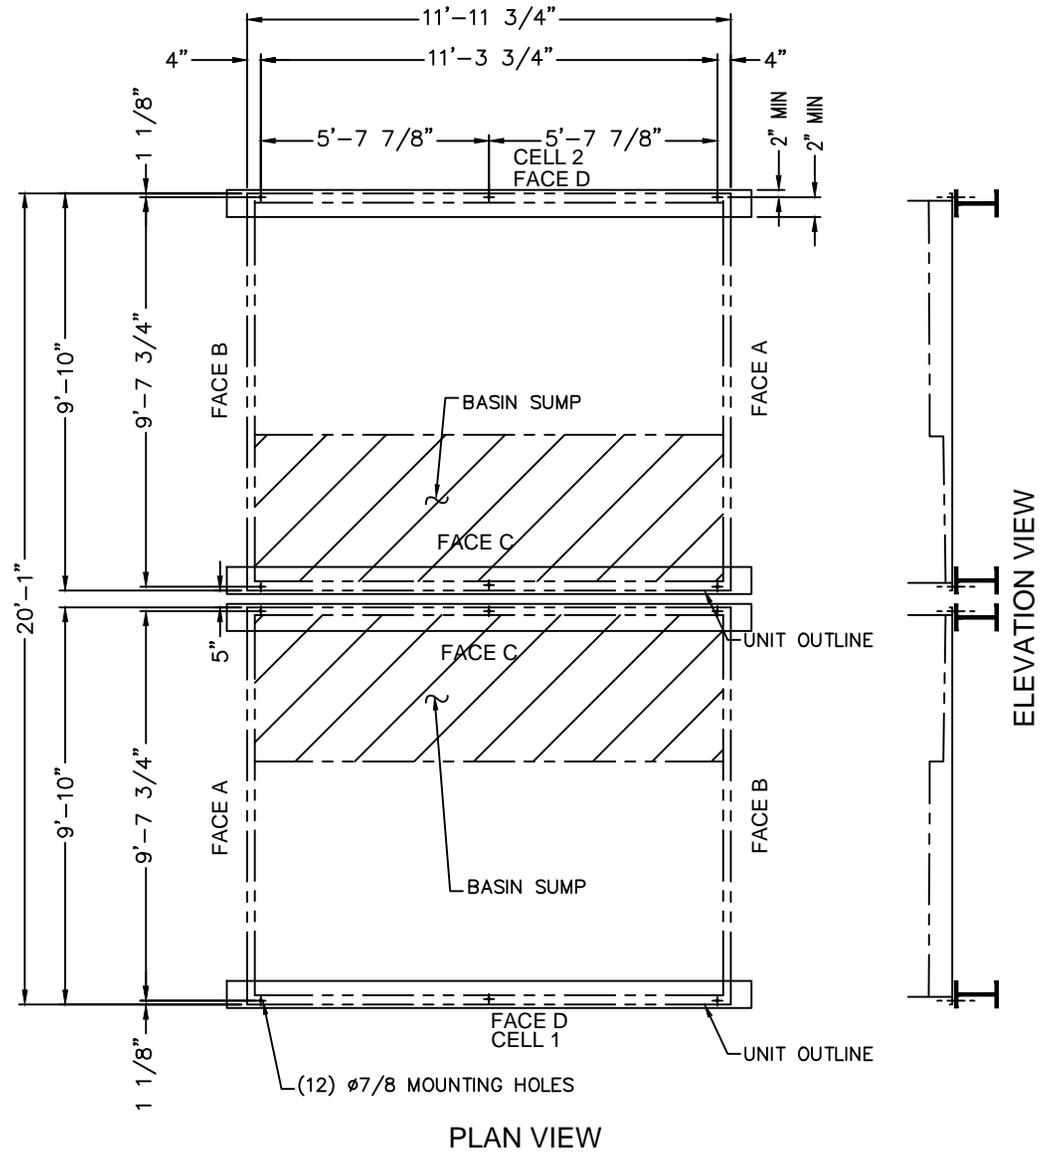

ORDER NO:

DATE:



BALTIMORE AIRCOIL COMPANY

**PCC Evaporative Condenser
Tabulated Steel Support - Plan A**

DRAWING NUMBER:
SS-PCI-2012