


Notes

- 1) Drawings are not to scale. All dimensions are in feet and inches. Weights are in pounds and include options and accessories.
- 2) Operating weight and weight loading are for units with water level in basin at overflow.
- 3) Unit support beams and anchor bolts to be designed and furnished by others.
- 4) Support beams must be flush and level at top.
- 5) All supporting steelwork must be designed in accordance with accepted structural practice. Maximum deflection of steelwork under unit to be 1/360 of span, not to exceed 1/2".
- 6) Each beam should be designed, as a minimum, for 65% of the total unit operation weight applied as a uniformly distributed load.

PLAN A STEEL SUPPORT

Model Number	Approx, Shipping Weight	Approx, Operating Weight
PFI-2412N-2DXDS-X2	27070	40590
PFI-2412N-2DXES-X2	28880	42490
PFI-2412N-3DXDS-X2	31420	46730
PFI-2412N-3DXES-X2	33790	49190
PFI-2412N-4DXDS-X2	34980	51400
PFI-2412N-4DXES-X2	37950	55150
PFI-2412N-5DXDS-X2	40890	59780
PFI-2412N-5DXES-X2	42900	61880
PFI-2412N-6DXDS-X2	38870	56840
PFI-2412N-6DXES-X2	40940	58980

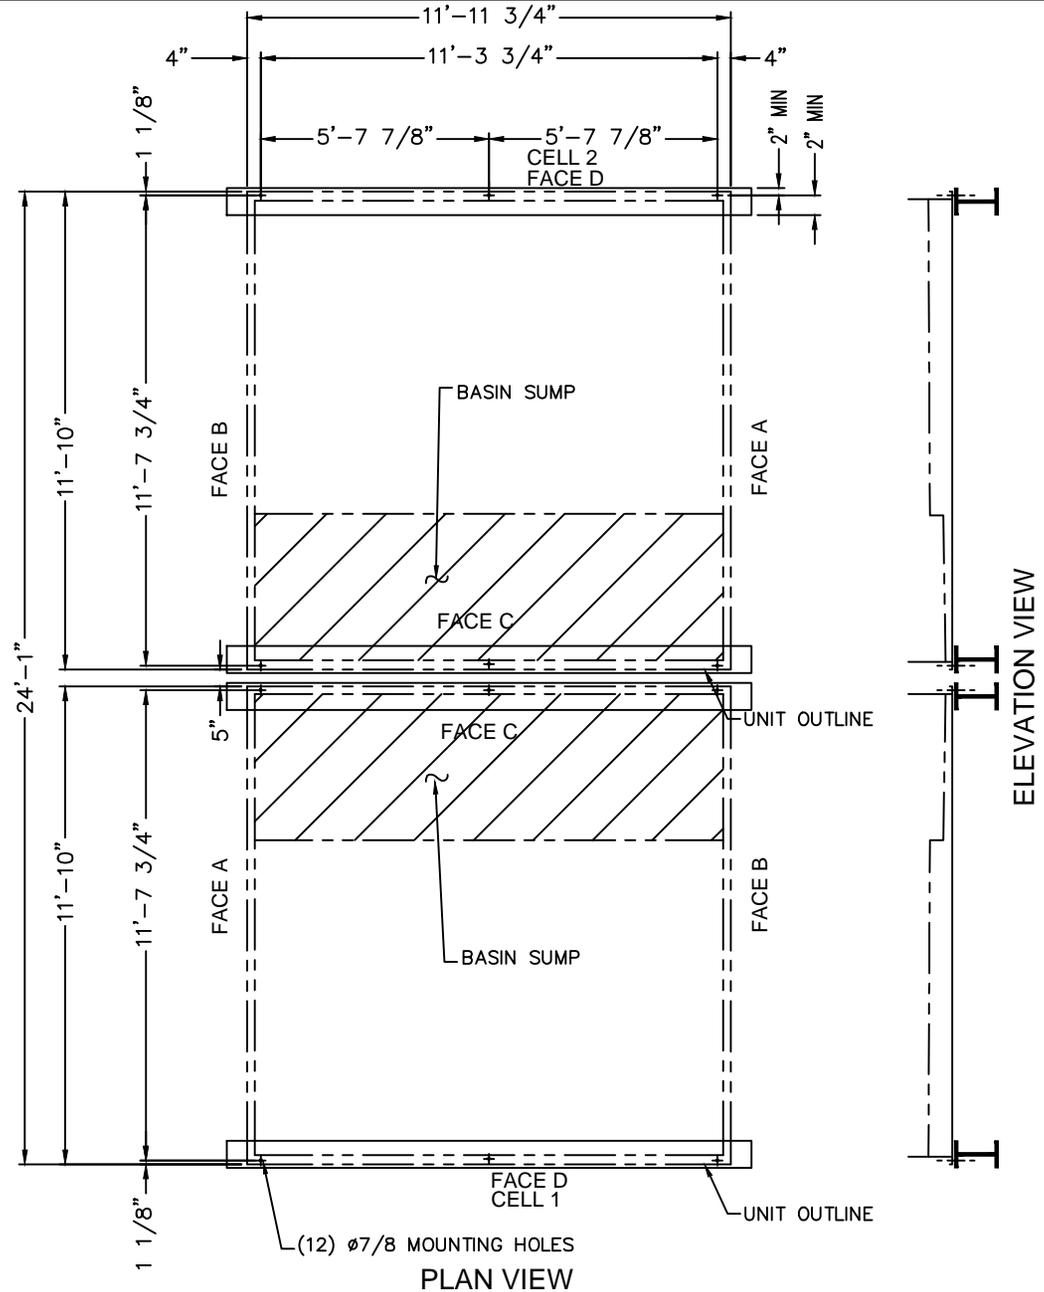

ORDER NO:

DATE:



BALTIMORE AIRCOIL COMPANY

**PFI Closed Circuit Cooling Tower
Tabulated Steel Support - Plan A**

DRAWING NUMBER:
SS-PFI-2412