


FACE D

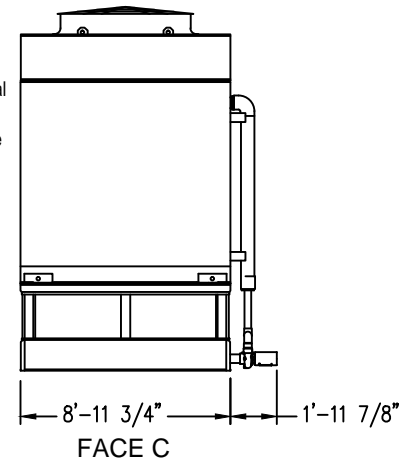

FACE C

Model Number	Approx. Shipping Weight	Approx. Operating Weight	Heaviest Section Weight	F	H
PCC-0113-0709N010	6890	10260	5540	4'-0 5/8"	13'-7 3/8"
PCC-0117-0709N7.5	7550	10970	6200	4'-0 5/8"	13'-7 3/8"
PCC-0142-0709N015	7550	10970	6200	4'-0 5/8"	13'-7 3/8"
PCC-0122-0709N7.5	7790	11220	6440	4'-0 5/8"	13'-7 3/8"
PCC-0154-0709N015	8710	12190	7370	4'-8 1/8"	14'-2 7/8"
PCC-0160-0709N020	8450	11910	7110	4'-8 1/8"	14'-2 7/8"
PCC-0166-0709N020	8770	12250	7430	4'-8 1/8"	14'-2 7/8"
PCC-0175-0709N020	9500	12990	8150	5'-11 1/8"	15'-5 7/8"
PCC-0130-0709N7.5	9140	12640	7790	5'-3 5/8"	14'-10 3/8"
PCC-0184-0709N020	11220	14820	9870	5'-11 1/8"	15'-5 7/8"

Notes

- 1) Drawings are not to scale. All dimensions are in feet and inches.
- 2) Unless otherwise indicated, connections 3" and smaller are MPT. Connections 4" and larger are grooved to suit a mechanical coupling and beveled for welding.
- 3) Dimensions showing location of coil and basin connections are approximate and should not be used for prefabrication of connecting piping.
- 4) For weight loadings and support requirements, refer to the suggested steel support drawing.
- 5) Heaviest section is the combined weight of fan and coil sections, refer to the P-Series Counterflow Induced Draft Coil Products rigging and assembly manual for suggested lifting method.
- 6) The area above the discharge must be unobstructed.
- 7) Do not support piping from unit connections. All necessary piping supports to be supplied by others.
- 8) M = Motor location
- 9) External motor assembly ships loose for field installation.

Right Hand Unit

ORDER NO:

DATE:



BALTIMORE AIRCOIL COMPANY

PCC Evaporative Condenser Tabulated Unit Print

DRAWING NUMBER:
UP-PCC-0709