


- Notes
- 1) Drawings are not to scale.
 - 2) All dimensions are in feet and inches. Weights are in pounds and include options and accessories.
 - 3) Operating weight and weight loading are for units with water level in cold water basin at overflow.
 - 4) Unit support beams and anchor bolts to be designed and furnished by others. Minimum dimensions shown in Section A-A are provided only to ensure proper support of unit.
 - 5) Support beams must be flush and level at top.
 - 6) Support beams are not limited to an I-beam shape.
 - 7) Each beam should be designed, as a minimum, for 65% of the total unit operating weight applied as a uniformly distributed load.
 - 8) If vibration isolators are used, they should be installed under the support beams and should never have direct contact with the unit.

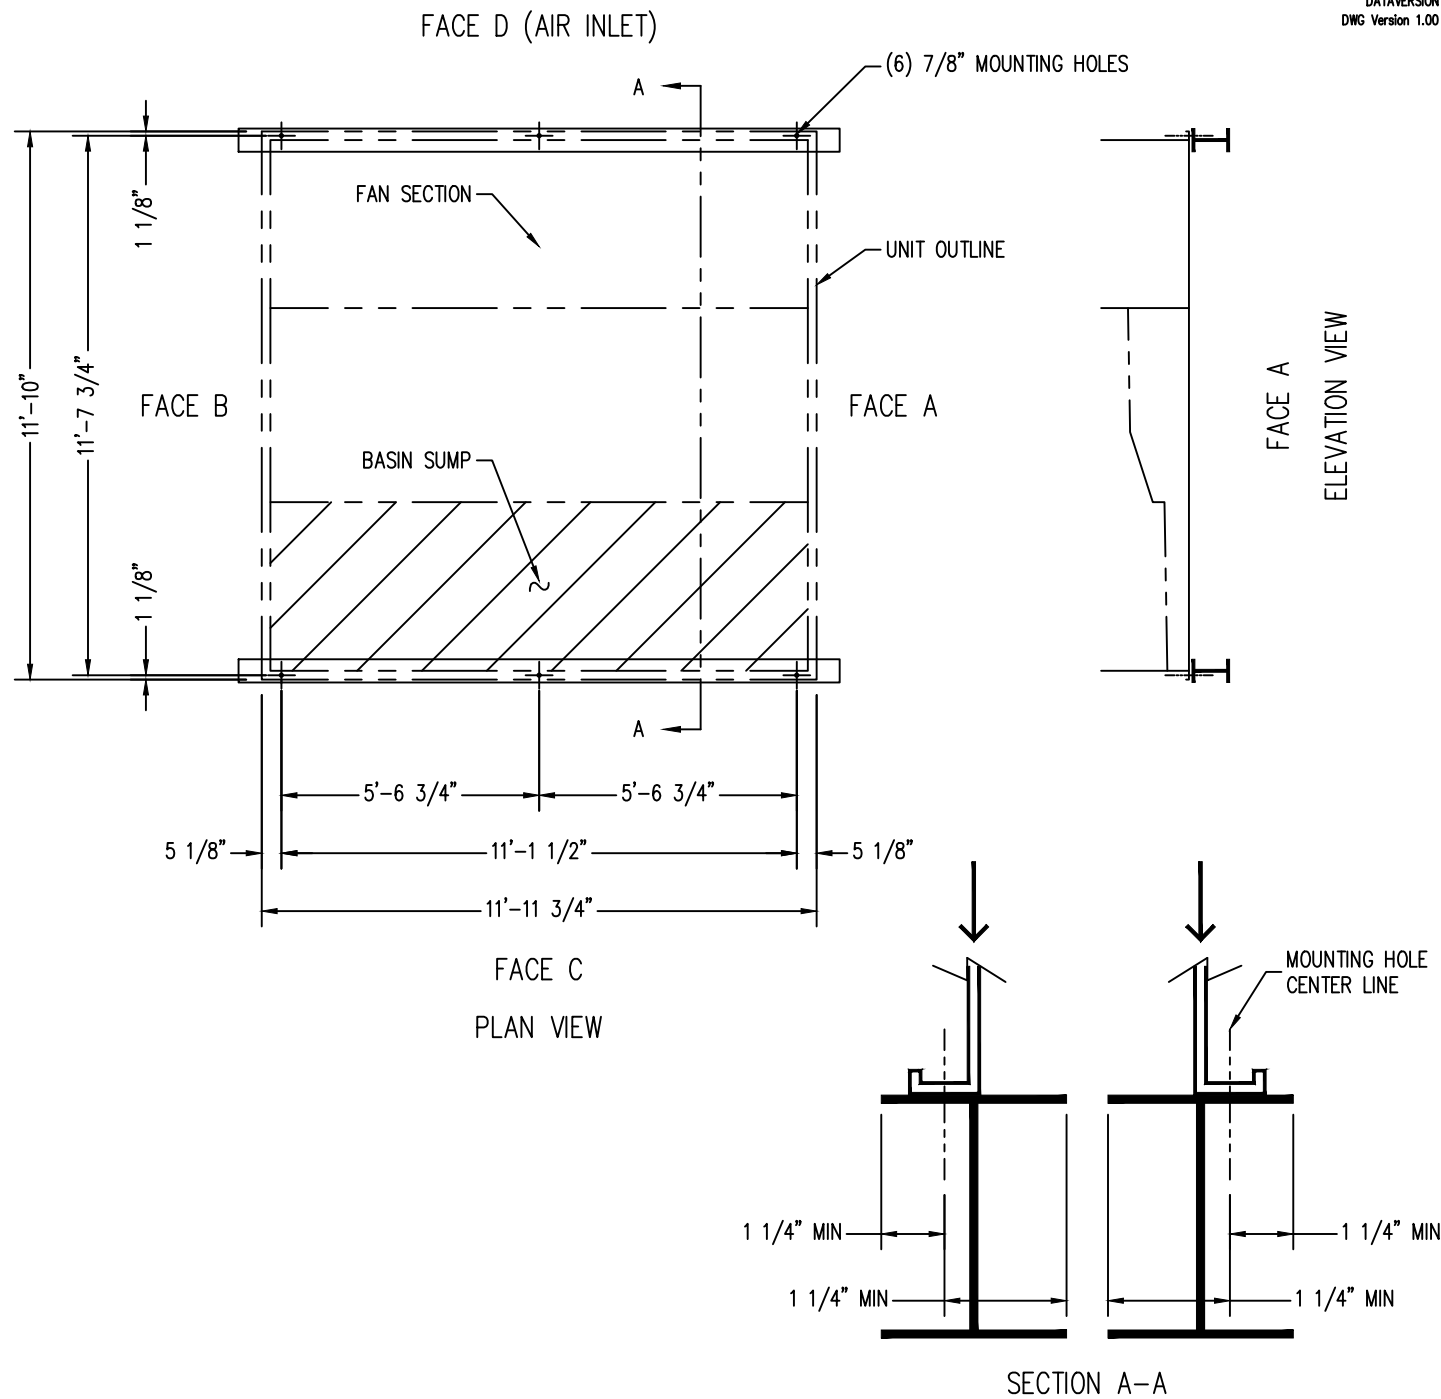

MODEL NO.	APPROX. SHIPPING WEIGHT	APPROX. OPERATING WEIGHT
VRC-0214B-1212N-GA	14300	19060
VRC-0243B-1212N-HA	14290	19060
VRC-0268B-1212N-JA	14420	19190
VRC-0287B-1212N-KA	14470	19230
VRC-0271B-1212N-HA	15410	20290
VRC-0298B-1212N-JA	15540	20410
VRC-0320B-1212N-KA	15590	20460
VRC-0349B-1212N-KA	17900	22880
VRC-0384B-1212N-LA	18220	23210
VRC-0412B-1212N-MA	18350	23330
VRC-0381B-1212N-KA	18880	23960
VRC-0415B-1212N-LA	19200	24280
VRC-0445B-1212N-MA	19330	24410
VRC-0469B-1212N-NA	19410	24490

ORDER NO:

DATE:



**Vertex™ Evaporative Condenser
Single Cell Unit Support**

DRAWING NUMBER: