


PLAN VIEW

Notes

- 1) Drawings are not to scale. All dimensions are in feet and inches. Weights are in pounds and include options and accessories.
- 2) Operating weight and weight loading are for units with water level in basin at overflow.
- 3) Unit support beams and anchor bolts to be designed and furnished by others.
- 4) Support beams must be flush and level at top.
- 5) All supporting steelwork must be designed in accordance with accepted structural practice. Maximum deflection of steelwork under unit to be 1/360 of span, not to exceed 1/2".
- 6) Each beam should be designed, as a minimum, for 65% of the total unit operation weight applied as a uniformly distributed load.

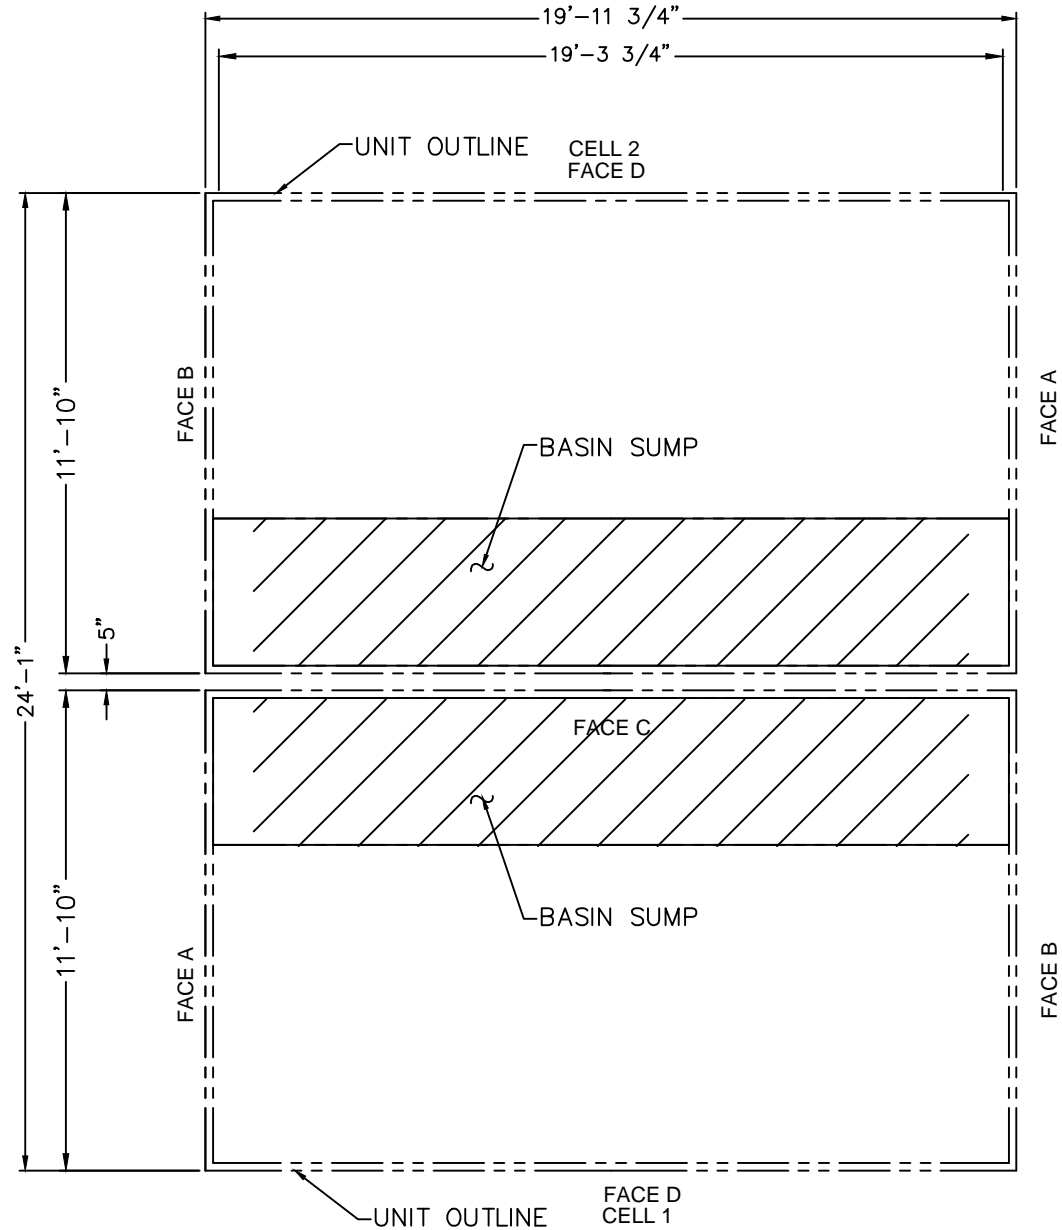

Model Number	Approx. Shipping Weight	Approx. Operating Weight
PCC-1088-2420N080	47897	71690
PCC-0862-2420N030	49701	73630
PCC-0982-2420N040	54821	79060
PCC-1080-2420N060	54981	79220
PCC-1162-2420N080	55421	79660
PCC-1228-2420N100	55471	79710
PCC-1038-2420N040	62957	87820
PCC-1114-2420N050	66957	92070
PCC-1134-2420N060	63117	87980
PCC-1160-2420N060	67057	92170
PCC-1182-2420N080	60277	84930
PCC-1244-2420N080	67497	92610
PCC-1280-2420N100	63607	88470
PCC-1318-2420N100	67547	92660
PCC-1378-2420N120	68049	93160

ORDER NO:

DATE:



BALTIMORE AIRCOIL COMPANY

PCC Evaporative Condensator
Tabulated Steel Support - Plan A

DRAWING NUMBER:
SS-PCC-2420